

Auckland Water Supply Update

1 FEBRUARY 2021

Rainfall

Three weeks ago



79% less than normal



Two weeks ago



6% less than normal



Past 7 days

Hunua 0.5mm
Waitakere 2mm



95% less than normal




Coming 7 days



90% less than normal



Total water storage

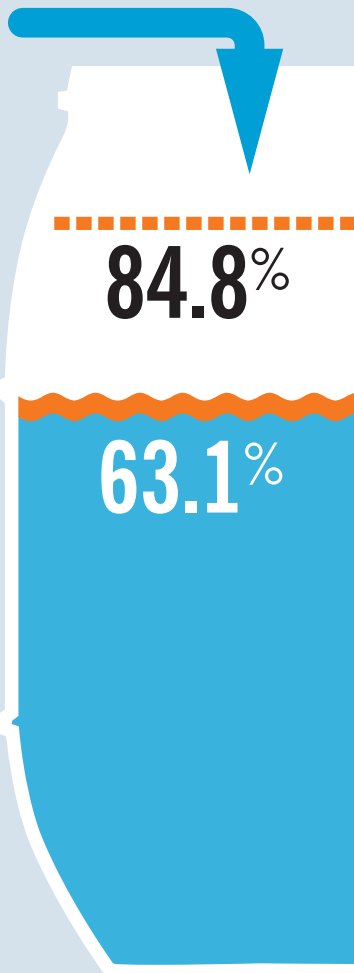

Average for this time of year →

84.8%

Actual storage →

63.1%

Total water usage



← Peak consumption in summer 2020

568 MLD*

← Target consumption for February 2021


511 MLD* (or less)

← Actual consumption (rolling 7-day average)

443 MLD*

*million litres per day

Water sources: past 7 days

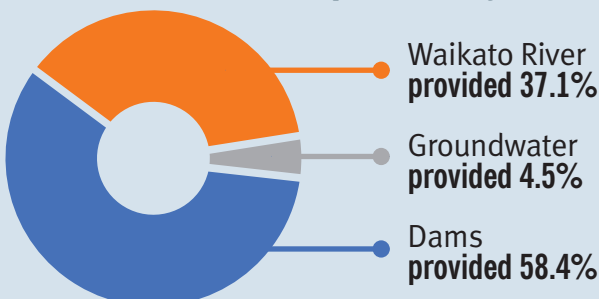

Waikato River provided 37.1%

Groundwater provided 4.5%

Dams provided 58.4%



Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Hays Creek, Papakura Deliver 6MLD* by February 2021

Onehunga expansion, Onehunga Deliver 4MLD* by April 2021

Hickey Springs Bores, Pukekohe Delivered 5MLD* in Oct 2020 ✓

Waikato expansion, Tuakau Delivered 25MLD* in August 2020 ✓