

Auckland Water Supply Update

11 JANUARY 2021

Rainfall

Three weeks ago



57% less than normal



Two weeks ago



43% less than normal



Past 7 days

Hunua 36mm
Waitakere 24.5mm



31% more than normal




Coming 7 days



70% less than normal



Total water storage

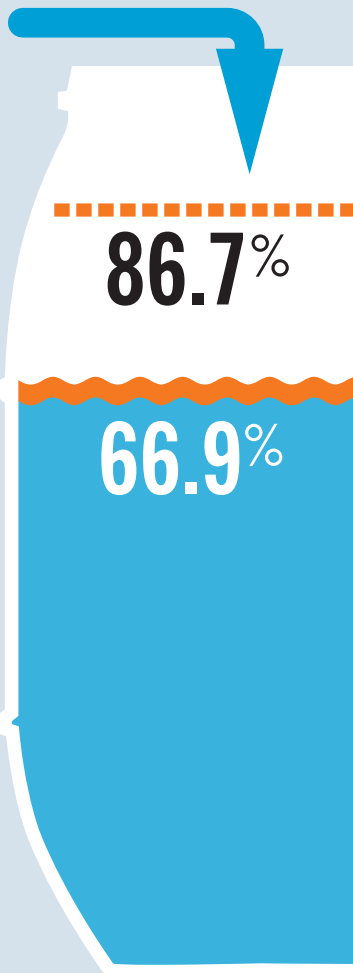

Average for this time of year

86.7%

Actual storage

66.9%

Total water usage



Peak consumption in summer 2020

568 MLD*

Target consumption for January 2021


461 MLD* (or less)

Actual consumption (rolling 7-day average)

413 MLD*

*million litres per day

Water sources: past 7 days

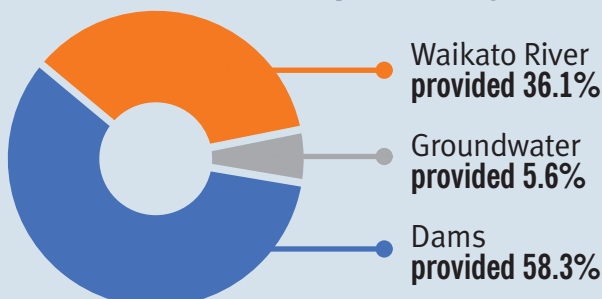

Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Hays Creek, Papakura **Deliver 6MLD* by January 2021**

Onehunga expansion, Onehunga **Deliver 4MLD* by Jan 2021**

Hickey Springs Bores, Pukekohe **Delivered 5MLD* in Oct 2020** ✓

Waikato expansion, Tuakau **Delivered 25MLD* in August 2020** ✓

