

# Auckland Water Supply Update

30 NOVEMBER  
2020

## Rainfall

Three  
weeks ago



37% less  
than normal



Two  
weeks ago



75% less  
than normal



Past  
7 days



Hunua  
32.5mm  
Waitakere  
33mm

15% more  
than normal



Coming  
7 days



39% less  
than normal



## Total water storage

Average  
for this time  
of year




90.8%

Actual  
storage



72.5%

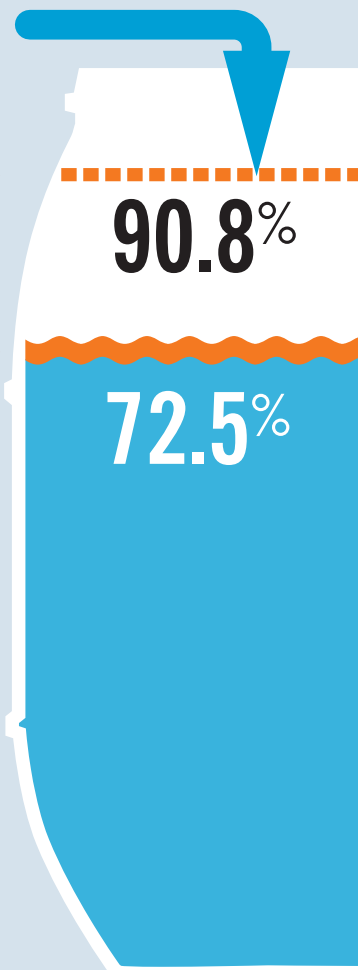

## Total water usage

Peak  
consumption in  
summer 2020



568MLD\*

Target  
consumption  
for November 2020




433MLD\*  
(or less)

Actual  
consumption  
(rolling 7-day average)




397MLD\*

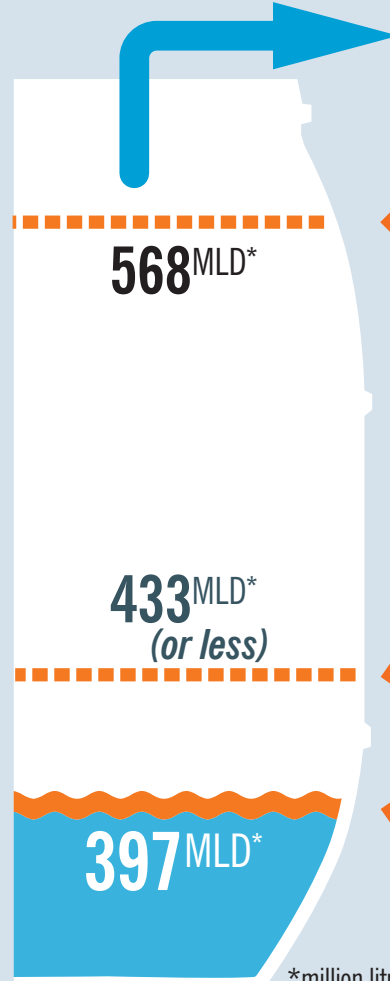

\*million litres per day

## Water sources: past 7 days

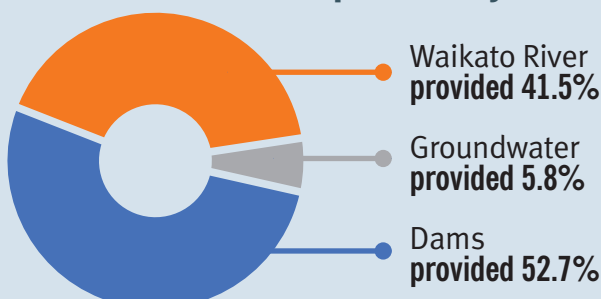

## Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Hays Creek, Papakura **Deliver 6MLD\* by January 2021**

Onehunga expansion, Onehunga **Deliver 4MLD\* by Jan 2021**

Hickey Springs Bores, Pukekohe **Delivered 5MLD\* in Oct 2020** ✓

Waikato expansion, Tuakau **Delivered 25MLD\* in August 2020** ✓

