

# Auckland Water Supply Update

31 MAY 2021

## Rainfall

Three weeks ago



21% more than normal



Two weeks ago



51% less than normal



Past 7 days

Hunua 24mm  
Waitakere 23mm



33% less than normal




Coming 7 days



39% less than normal



## Total water storage

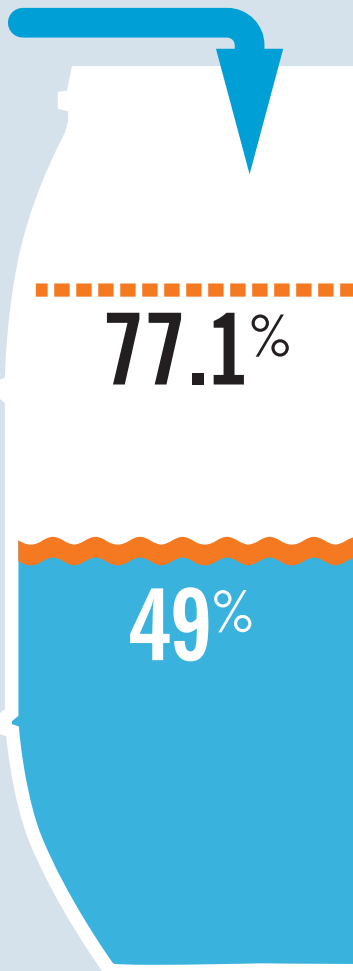

Average for this time of year

77.1%

Actual storage

49%

## Total water usage



Peak consumption in summer 2020

568MLD\*

Target consumption for June


410MLD\* (or less)

Actual consumption (rolling 7-day average)

405MLD\*

\*million litres per day

## Water sources: past 7 days

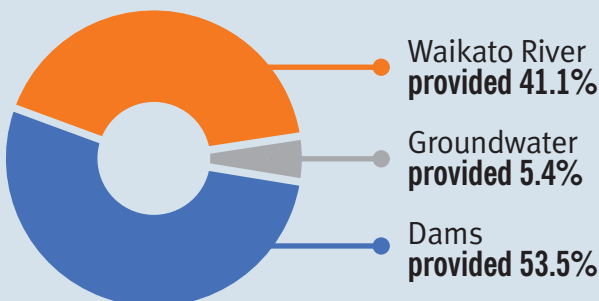

Waikato River provided 41.1%

Groundwater provided 5.4%

Dams provided 53.5%



## Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Onehunga expansion, Onehunga Deliver 4MLD\* by June 2021

Waikato 50 water treatment plant Deliver 50MLD\* by winter 2021

Hays Creek, Papakura Delivered 6MLD\* by February 2021 ✓

Hickey Springs Bores, Pukekohe Delivered 5MLD\* in Oct 2020 ✓

Waikato expansion, Tuakau Delivered 25MLD\* in August 2020 ✓