

# Auckland Water Supply Update

5 APRIL 2021

## Rainfall

Three weeks ago



87% less than normal



Two weeks ago



99% less than normal



Past 7 days

Hūnua 28.5mm  
Waitakere 27.5mm



8% more than normal




Coming 7 days



18% more than normal



## Total water storage

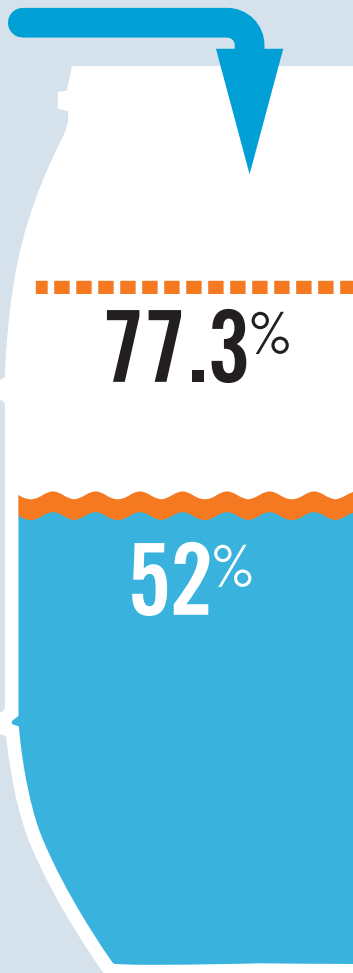

Average for this time of year →

77.3%

Actual storage →

52%

## Total water usage



← Peak consumption in summer 2020

568 MLD\*

← Target consumption for this week\*\*


445 MLD\* (or less)

← Actual consumption (rolling 7-day average)

394 MLD\*

\* million litres per day  
\*\* There are two targets for April – 445MLD for the first half of the month, 425MLD for the second half.

## Water sources: past 7 days

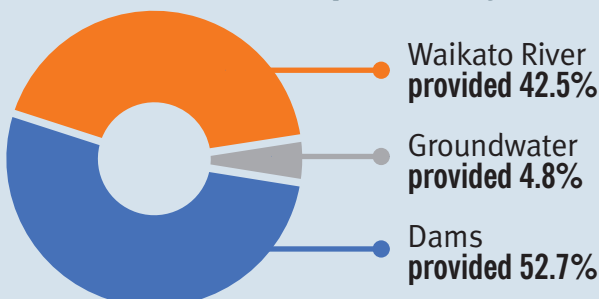

Waikato River provided 42.5%

Groundwater provided 4.8%

Dams provided 52.7%



## Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Onehunga expansion, Onehunga Deliver 4MLD\* by April 2021

Waikato 50 water treatment plant Deliver 50MLD\* by winter 2021

Hays Creek, Papakura Delivered 6MLD\* by February 2021 ✓

Hickey Springs Bores, Pukekohe Delivered 5MLD\* in Oct 2020 ✓

Waikato expansion, Tuakau Delivered 25MLD\* in August 2020 ✓