

Auckland Water Supply Update

19 JULY 2021

Rainfall

Three weeks ago



75% less than normal



Two weeks ago



38% less than normal



Past 7 days



Hunua 37.5mm
Waitakere 28.5mm

28% less than normal




Coming 7 days



50% less than normal



Total water storage

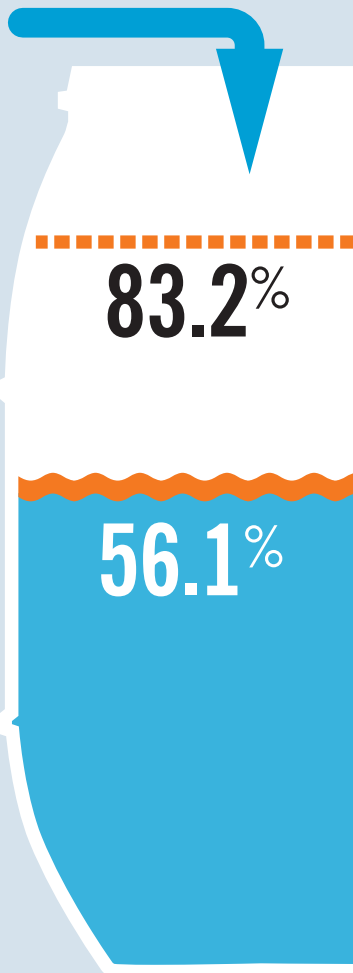

Average for this time of year

Actual storage

Total water usage




Peak consumption in summer 2020

Target consumption for July

Actual consumption (rolling 7-day average)

*million litres per day

Water sources: past 7 days

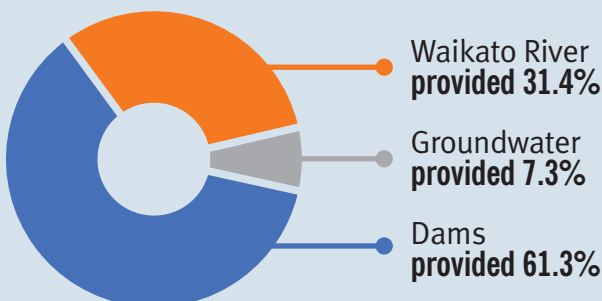

Water sources: being developed

We are bringing a former water storage dam and bore back into service, and expanding the Waikato and Onehunga treatment plants.

Waikato 50 water treatment plant **Deliver 50MLD* by winter 2021** ✓

Onehunga expansion, Onehunga **Deliver 4MLD* by June 2021** ✓

Hays Creek, Papakura **Delivered 6MLD* by February 2021** ✓

Hickey Springs Bores, Pukekohe **Delivered 5MLD* in Oct 2020** ✓

Waikato expansion, Tuakau **Delivered 25MLD* in August 2020** ✓

